



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
0	ISSUED FOR REVIEW		

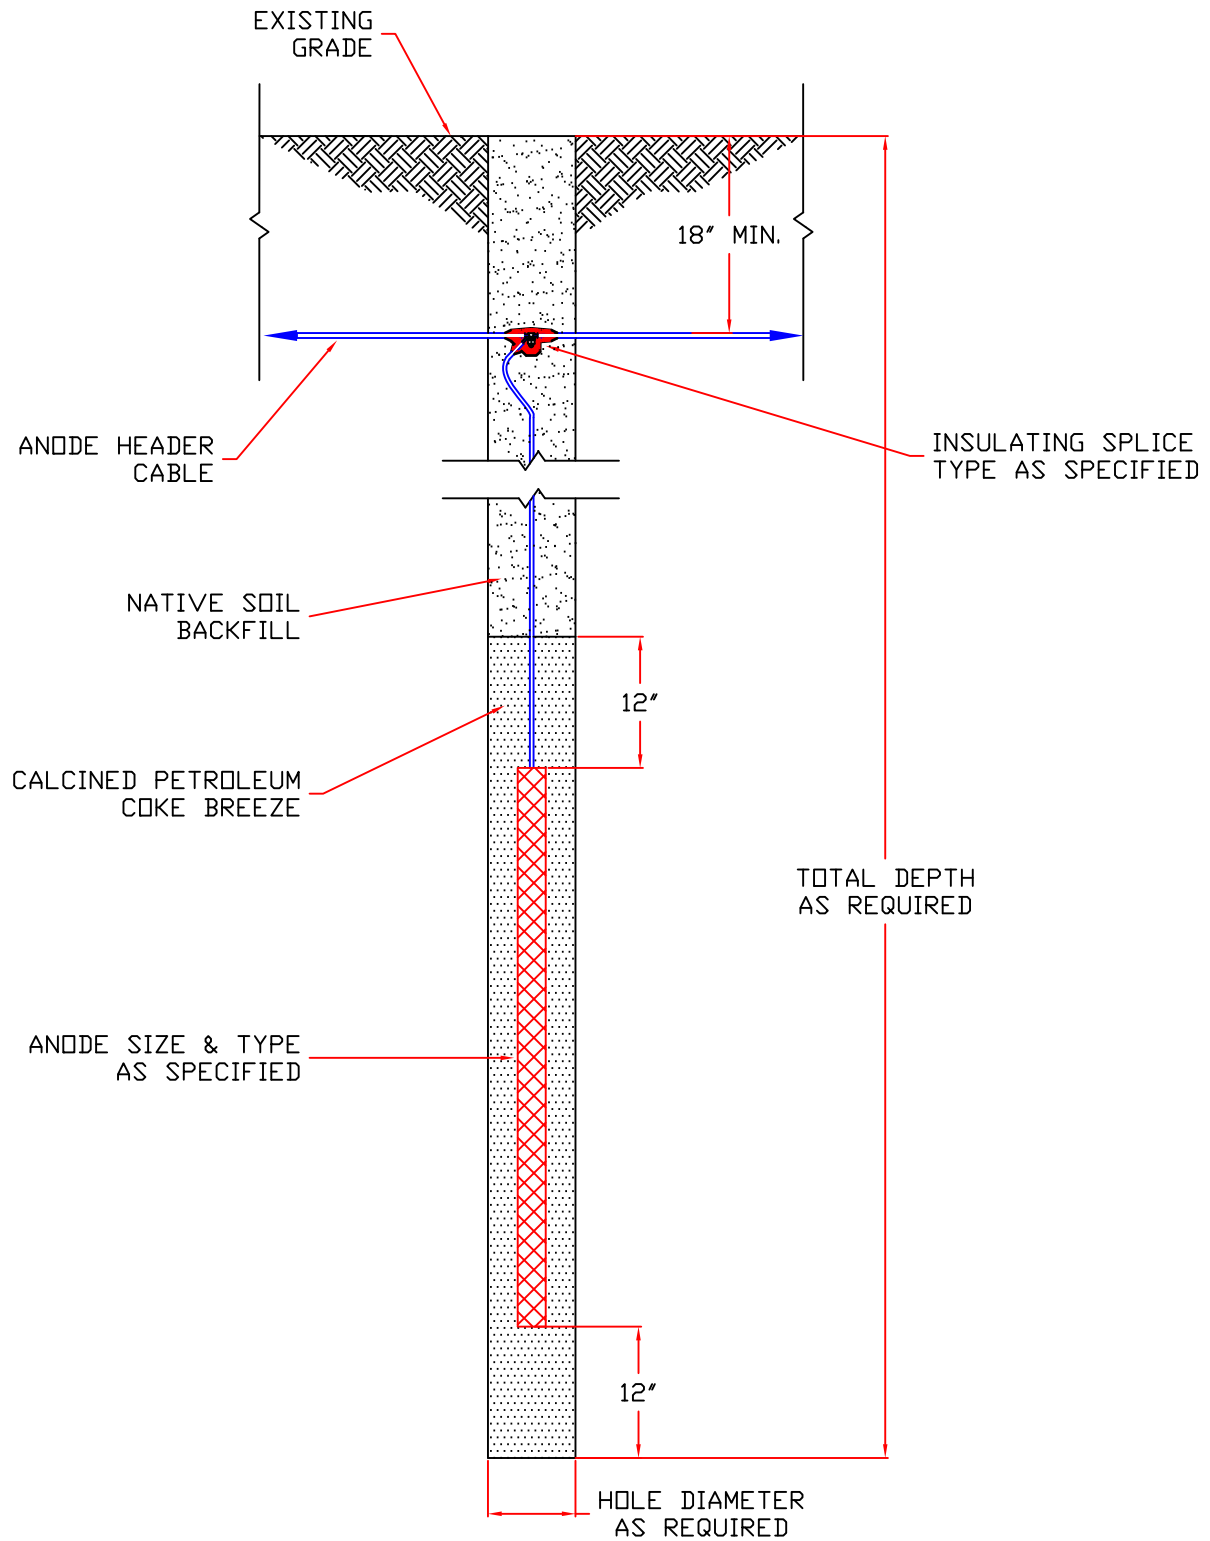

DRAWN BY T.S.H. 4/09		ENGINEER		JOB NO.		FARWEST CORROSION CONTROL COMPANY 1480 W. Artesia Blvd. Gardena, California	
		TYPICAL VERTICALLY INSTALLED ANODE INSTALLATION				DWG NO. S-5H	
		SIZE A	SCALE NONE		REV 0	SHEET 1 of 1	
FILE S-5H							