



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
0	ISSUED FOR REVIEW		

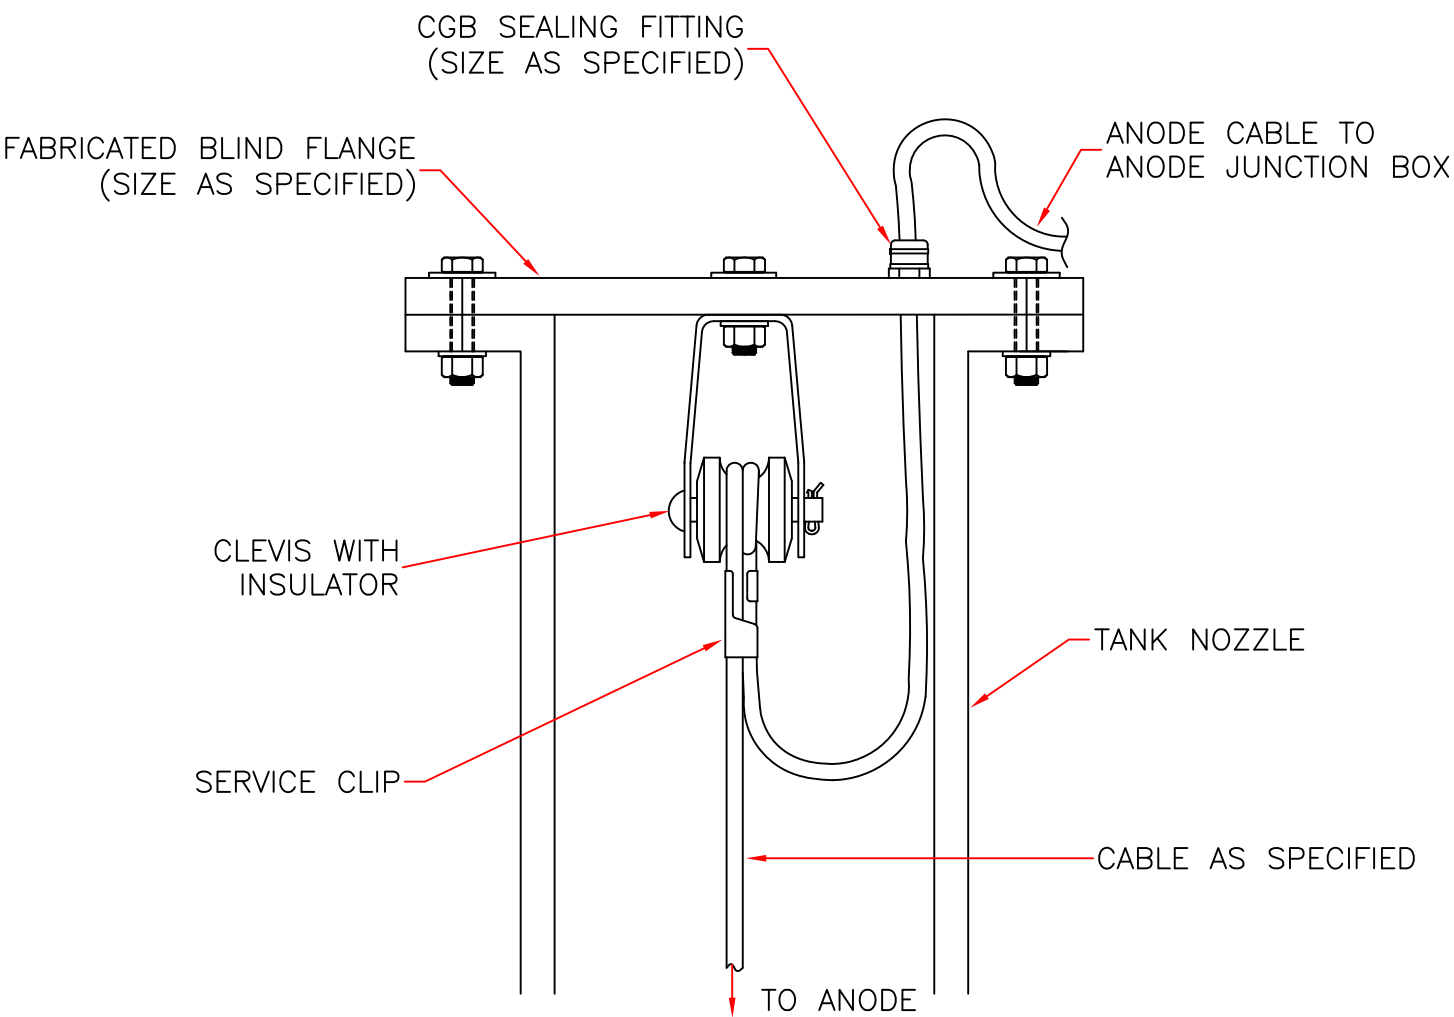

DRAWN BY T.S.H. 4/09		ENGINEER		FARWEST CORROSION CONTROL COMPANY 1480 W. Artesia Blvd. Gardena, California	
JOB NO.		TYPICAL CATHODIC PROTECTION TANK HANGER ASSEMBLY			
					
SIZE A	FILE S-16E-1			SCALE NONE	DWG NO. S-16E-1
REV 0			SHEET 1 of 1		