
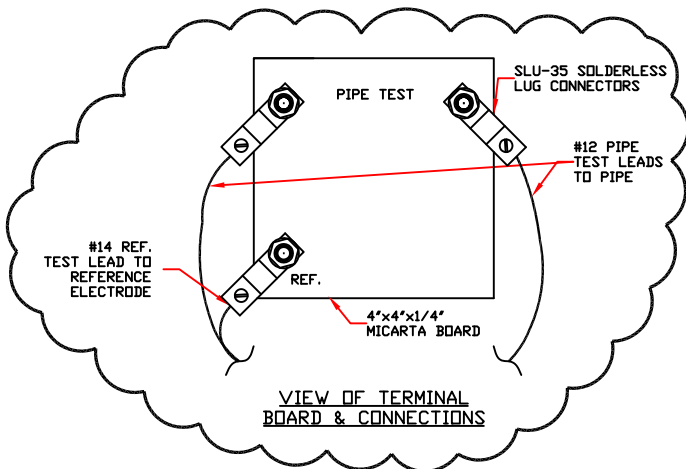



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
0	ISSUED FOR REVIEW		

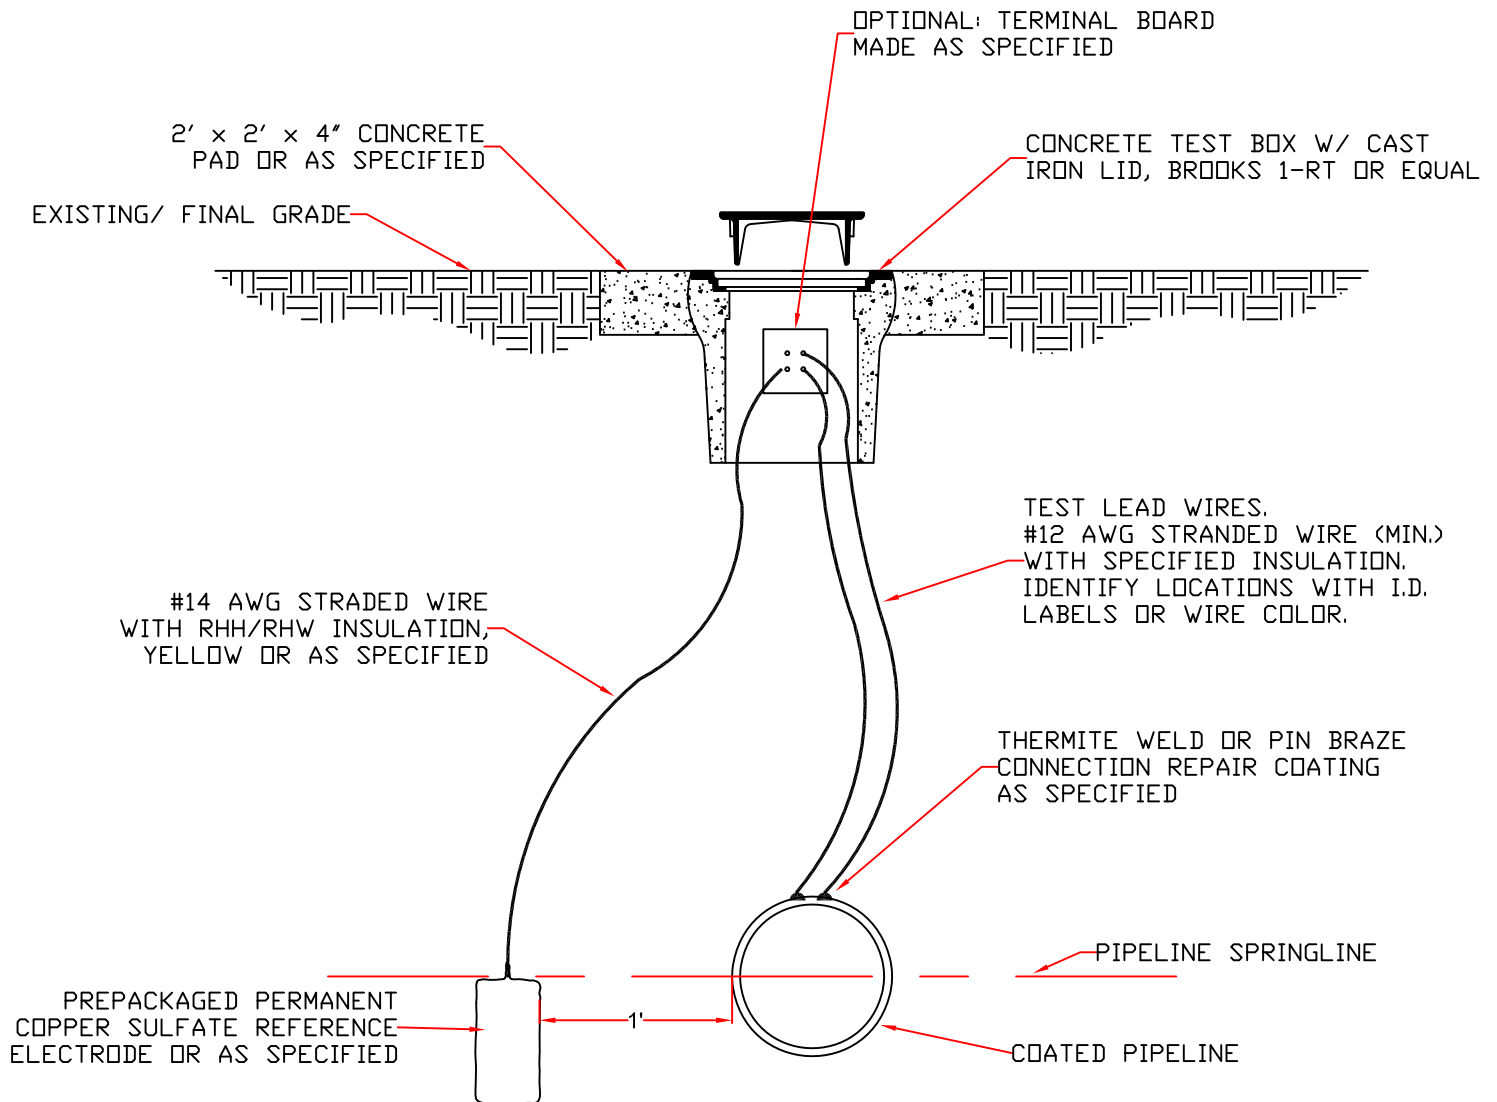

DRAWN BY T.S.H. 12/08		FARWEST CORROSION CONTROL COMPANY	
ENGINEER		1480 W. Artesia Blvd. Gardena, California	
JOB NO.		TYPICAL CATHODIC PROTECTION POTENTIAL TEST STATION WITH COPPER SULFATE REF. ELECTRODE	
		SIZE A	DWG NO. S-2J-CCS
		FILE S-2J-CCS	SCALE NONE
		REV 0	SHEET 1 of 1