



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
0	ISSUED FOR REVIEW		

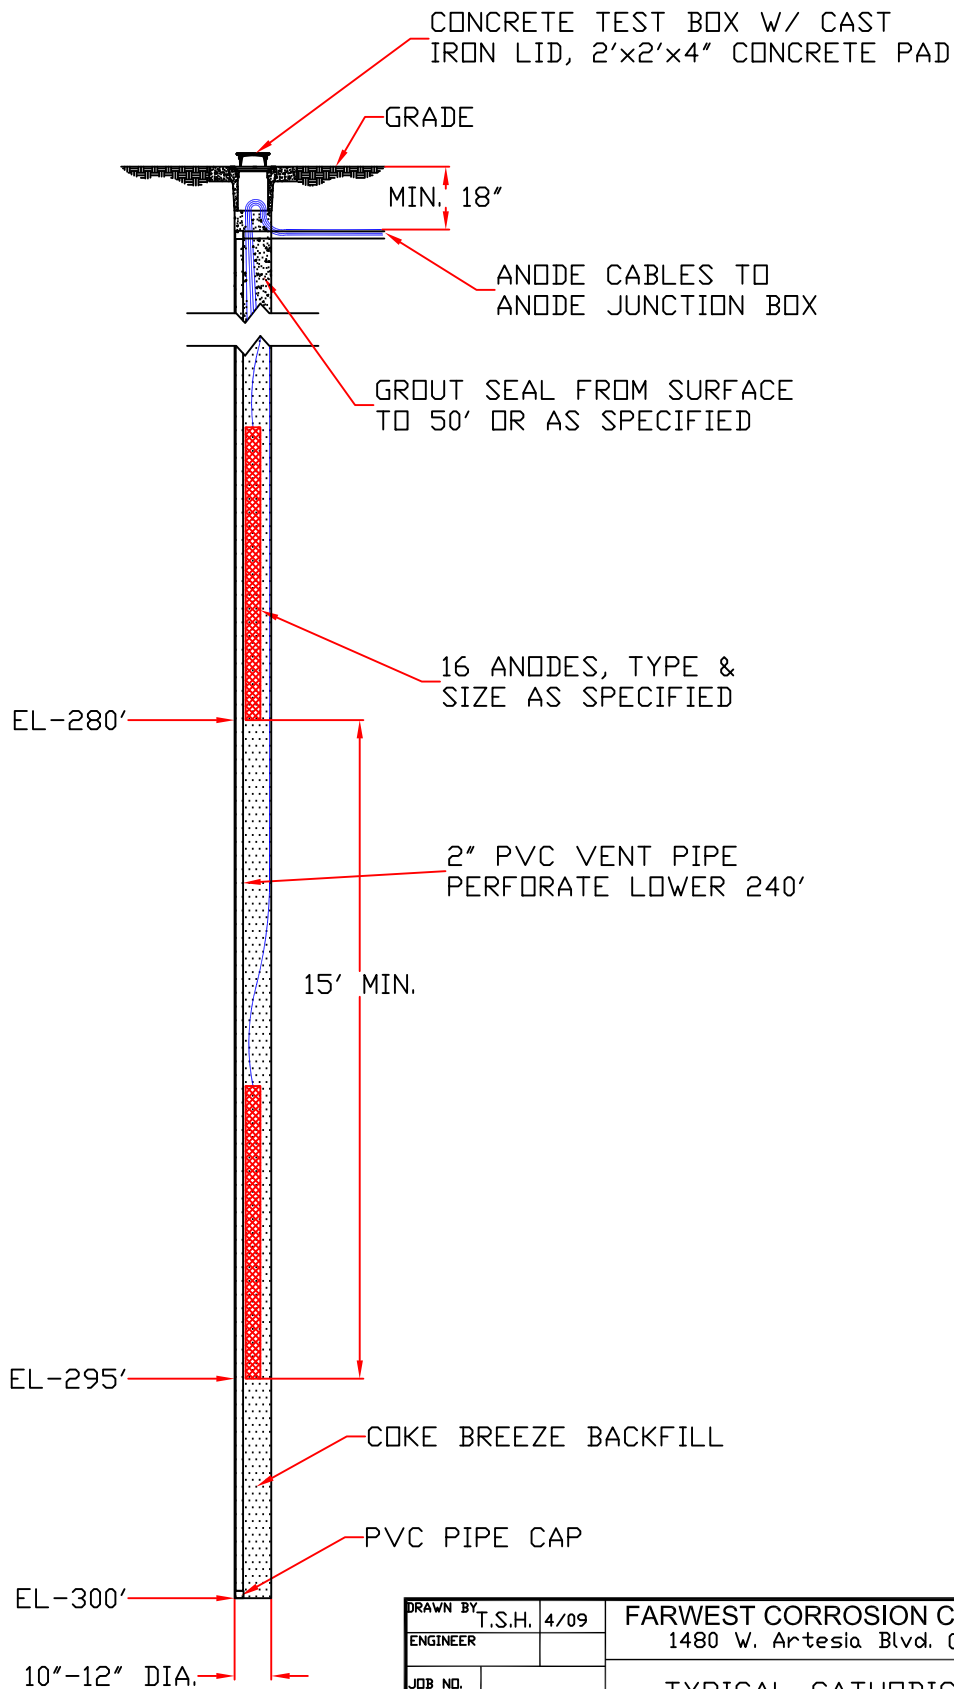

DRAWN BY T.S.H. 4/09		FARWEST CORROSION CONTROL COMPANY	
ENGINEER		1480 W. Artesia Blvd. Gardena, California	
JOB NO.		TYPICAL CATHODIC PROTECTION 300' DEEP WELL, 16 ANODE INSTALLATION	
		SIZE A	DWG NO. S-7E
		FILE S-7E	SCALE NONE
		REV 0	SHEET 1 of 1