
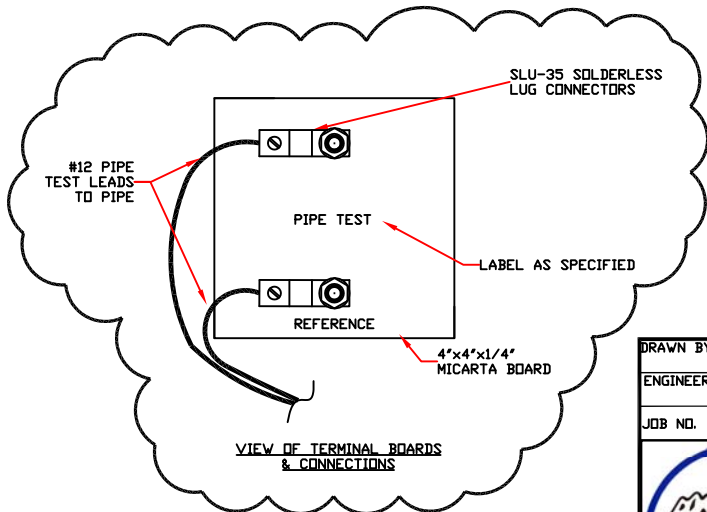



| REVISIONS | | | |
|-----------|-------------------|------|----------|
| REV | DESCRIPTION | DATE | APPROVED |
| 0 | ISSUED FOR REVIEW | | |

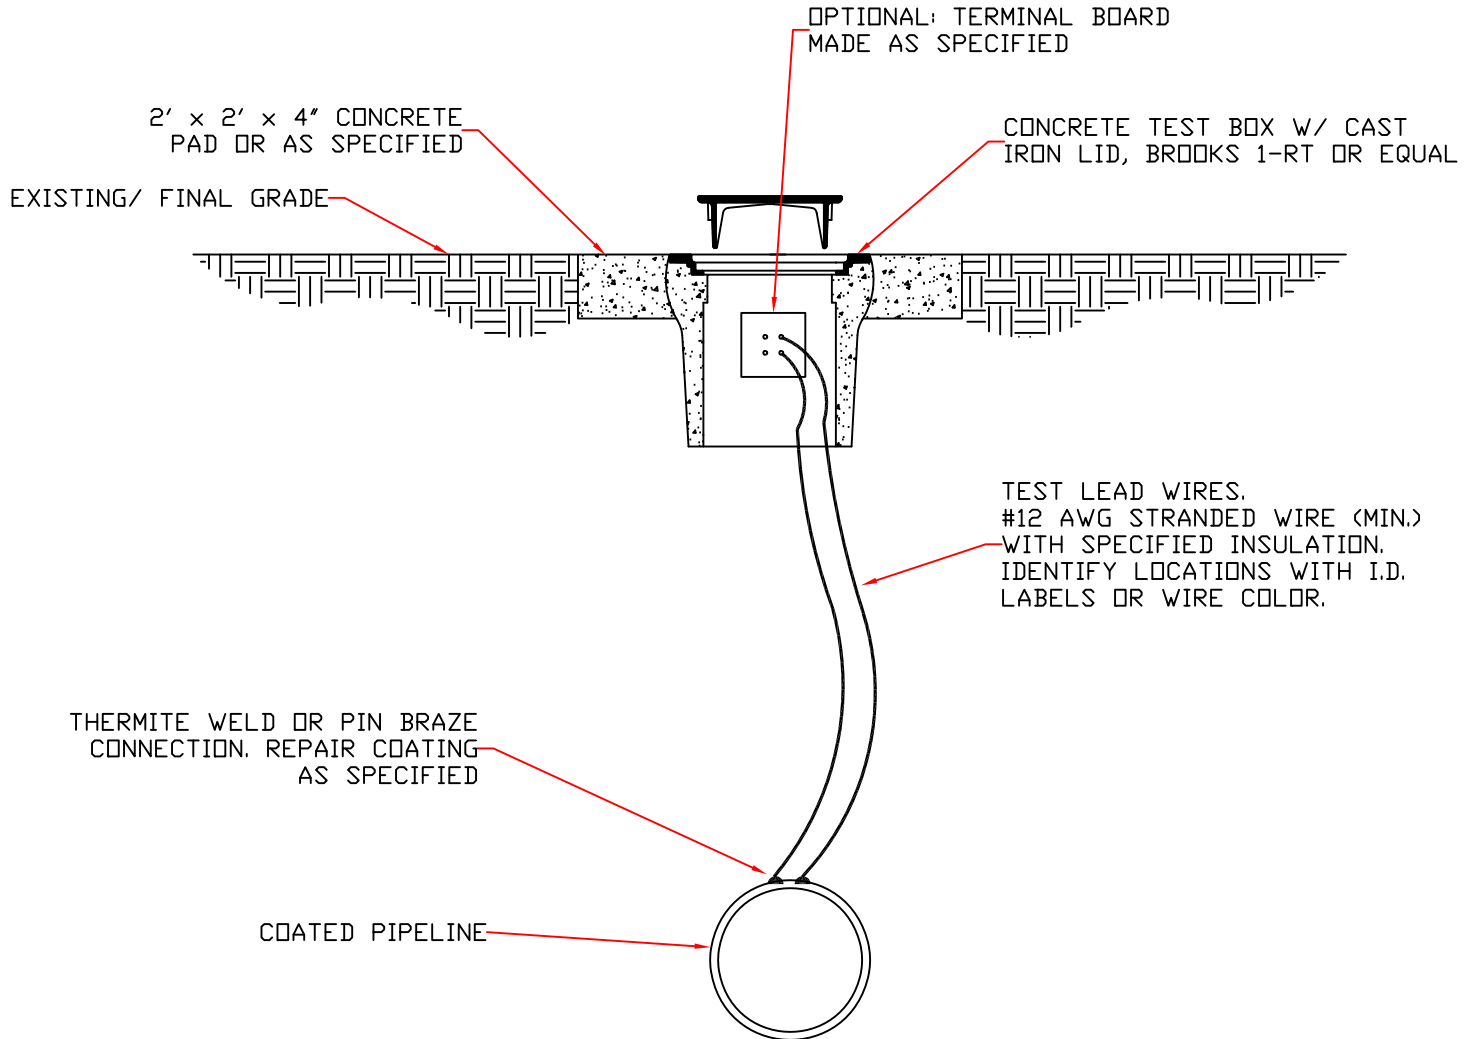

| | | | | | |
|---|--|--|-----------------|--|-----------------|
| DRAWN BY T.S.H. 12/08 | | ENGINEER | | FARWEST CORROSION CONTROL COMPANY 1480 W. Artesia Blvd. Gardena, California | |
| JOB NO. | | TYPICAL CATHODIC PROTECTION AT-GRADE TEST STATION MULTIPLE PIPELINES | | | |
|  | | SIZE A | DWG NO. S-2J | | |
| | | FILE S-2J | SCALE NONE | REV 0 | SHEET 1 of 1 |