



| REVISIONS |                   |      |          |
|-----------|-------------------|------|----------|
| REV       | DESCRIPTION       | DATE | APPROVED |
| 0         | ISSUED FOR REVIEW |      |          |

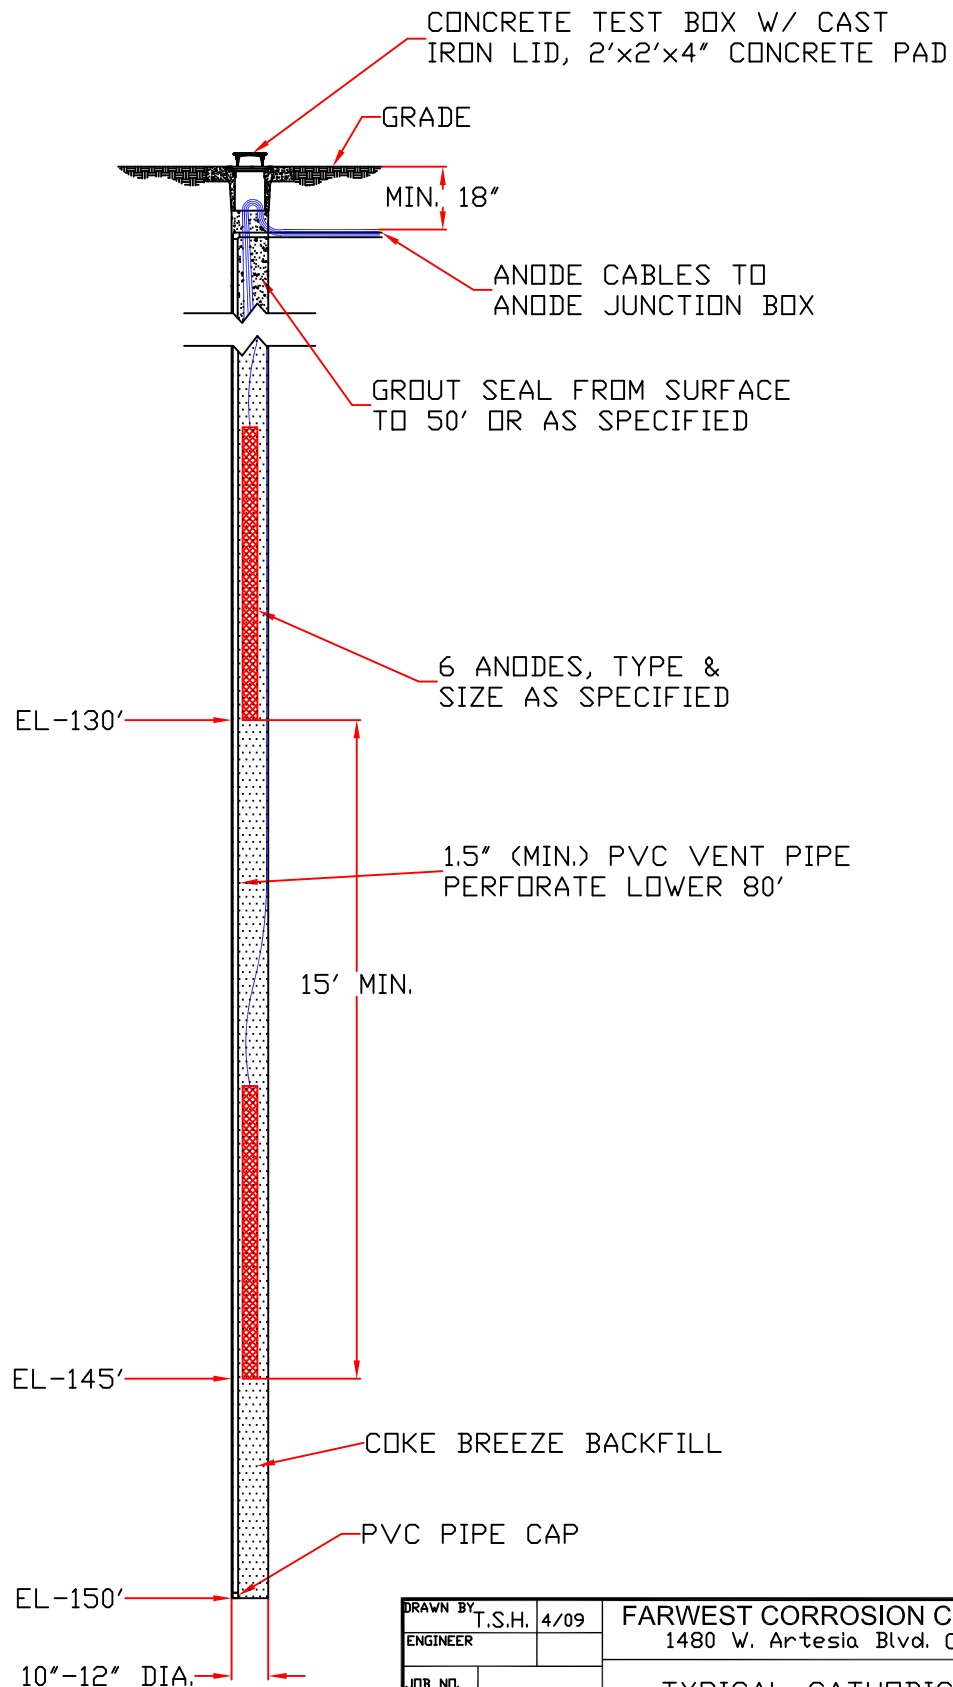

|   |  |  |                 |
|---|--|--|-----------------|
| DRAWN BY<br>T.S.H. 4/09   |  | FARWEST CORROSION CONTROL COMPANY<br>1480 W. Artesia Blvd. Gardena, California |                 |
| ENGINEER  |  |  |                 |
| JOB NO.   |  | TYPICAL CATHODIC PROTECTION<br>150' DEEP WELL, 6 ANODE<br>INSTALLATION         |                 |
|  |  | SIZE<br>A  | DWG NO.<br>S-7B |
|   |  | FILE<br>S-7B   | SCALE<br>NONE   |
|   |  | REV<br>0   | SHEET<br>1 of 1 |